


Unknown 43

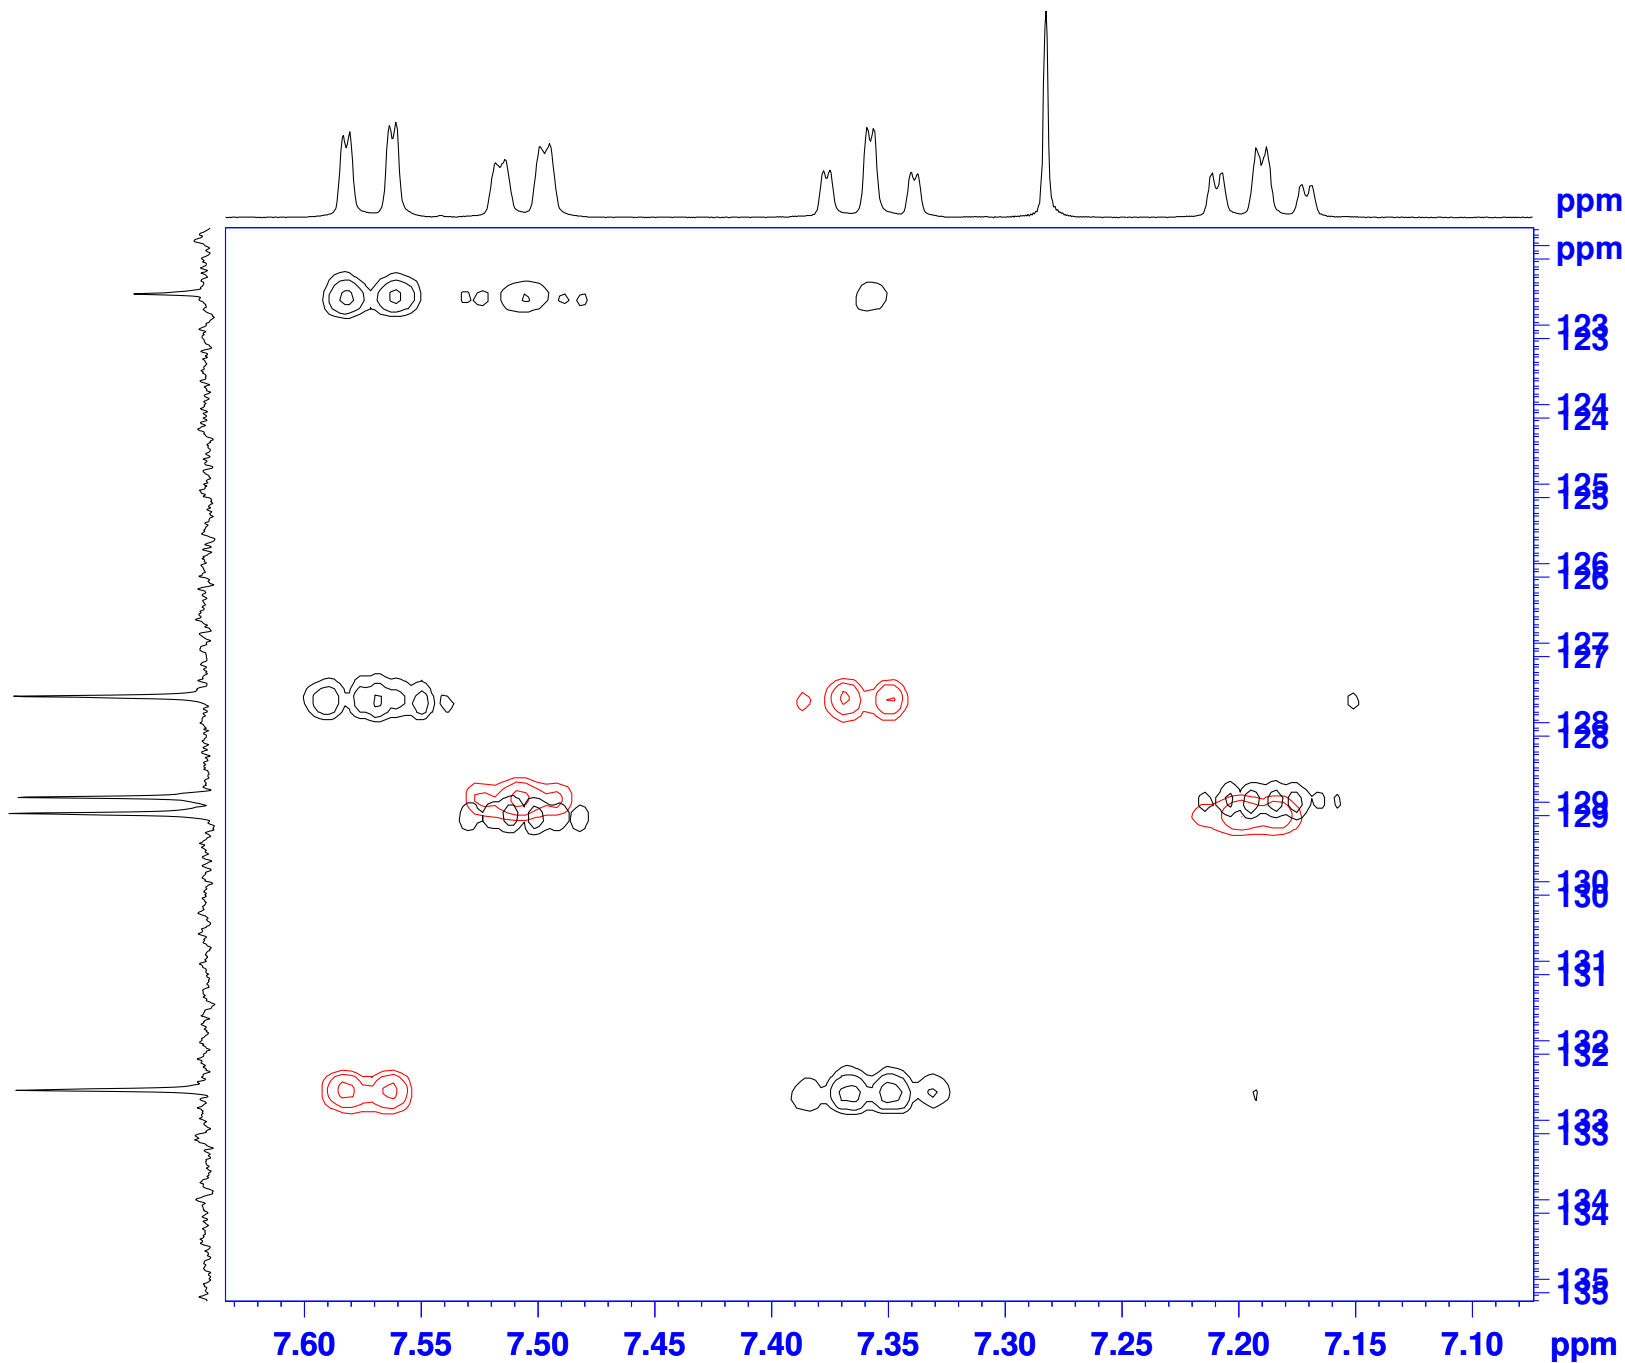

```

NAME          Un_43
EXPNO         4
PROCNO        1
Date_         20120221
Time          10.48
INSTRUM       robinson
PROBHD        5 mm PABBO BB-
PULPROG       hsqcetgp
TD            2048
SOLVENT       CDC13
NS            2
DS            16
SWH           3591.954 Hz
FIDRES        1.753884 Hz
AQ            0.2851316 sec
RG            18390.4
DW            139.200 usec
DE            6.50 usec
TE            298.4 K
CNST2         145.0000000
D0            0.00000300 sec
D1            2.00000000 sec
D4            0.00172414 sec
D11           0.03000000 sec
D13           0.00000400 sec
D16           0.00020000 sec
D21           0.00345000 sec
IN0           0.00004970 sec
ZGOPTNS

===== CHANNEL f1 =====
NUC1           1H
P1             10.90 usec
P2             21.80 usec
P28            1000.00 usec
PL1            0.00 dB
SFO1           400.1418006 MHz

===== CHANNEL f2 =====
CPDPRG2        garp
NUC2           13C
P3             8.05 usec
P4             16.10 usec
PCPD2          65.00 usec
PL2            -2.00 dB
PL12           14.70 dB
SFO2           100.6253445 MHz

===== GRADIENT CHANNEL =====
GPNAM1        SINE.100
GPNAM2        SINE.100
GPZ1          80.00 %
GPZ2          20.10 %
P16           1000.00 usec
ND0           2
TD            256
SFO1          100.6253 MHz
FIDRES        39.306774 Hz
SW            100.000 ppm
FnMODE        Echo-Antiecho
SI            2048
SF            400.1400000 MHz
WDW           QSINE
SSB           2
LB            0.00 Hz
GB            0
PC            1.40
SI            2048
MC2           echo-antiecho
SF            100.6152830 MHz
WDW           QSINE
SSB           2
LB            0.00 Hz
GB            0
  
```