


Unknown 46

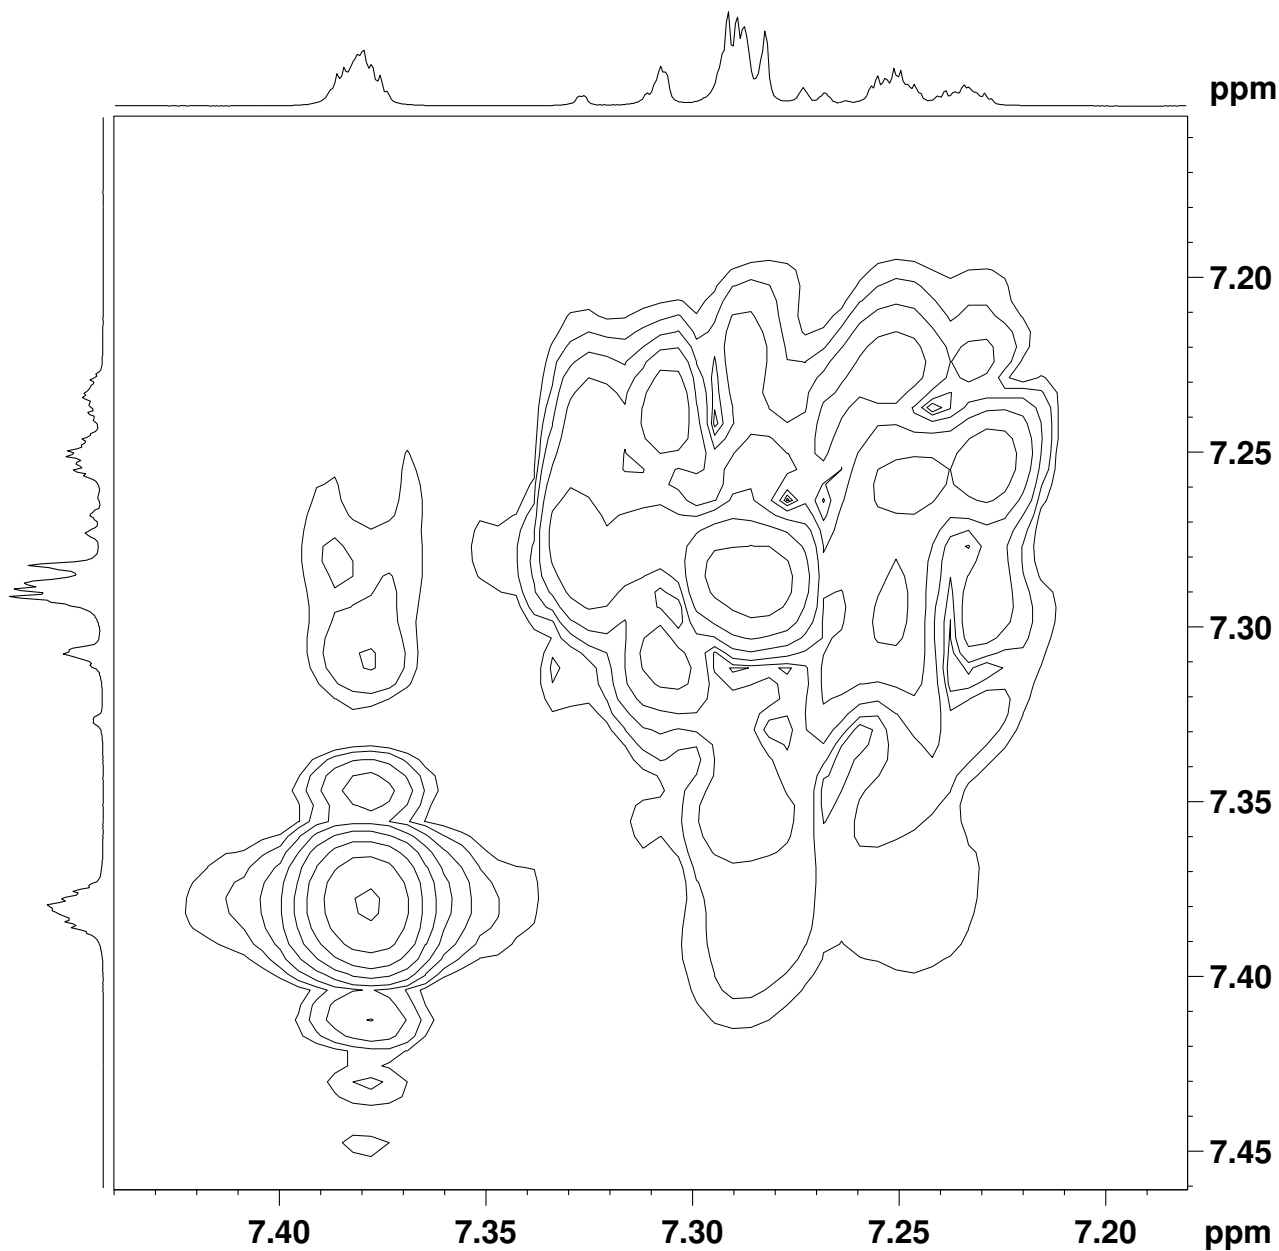

```
NAME           Un_46
EXPNO           3
PROCNO          1
Date_           20120222
Time            12.15
INSTRUM         robinson
PROBHD          5 mm PABBO BB-
PULPROG         cosygpgf
TD              2048
SOLVENT         CDC13
NS              2
DS              8
SWH             3591.954 Hz
FIDRES          1.753884 Hz
AQ              0.2851316 sec
RG              181
DW              139.200 usec
DE              6.50 usec
TE              298.4 K
D0              0.00000300 sec
D1              2.00000000 sec
D13             0.00000400 sec
D16             0.00020000 sec
IN0             0.00027840 sec
```

```
===== CHANNEL f1 =====
NUC1            1H
P0              14.00 usec
P1              14.00 usec
PL1             0.00 dB
SFO1            400.1418006 MHz
```

```
===== GRADIENT CHANNEL =====
GPNAM1         SINE.100
GPZ1           10.00 %
P16            1000.00 usec
ND0            1
TD             256
SFO1            400.1418 MHz
FIDRES          14.031069 Hz
SW              8.977 ppm
FnMODE         QF
SI             2048
SF             400.1400000 MHz
WDW            SINE
SSB            0
LB             0.00 Hz
GB            0
PC             1.40
SI             2048
MC2            QF
SF             400.1400000 MHz
WDW            SINE
SSB            0
LB             0.00 Hz
GB            0
```