


Unknown 47

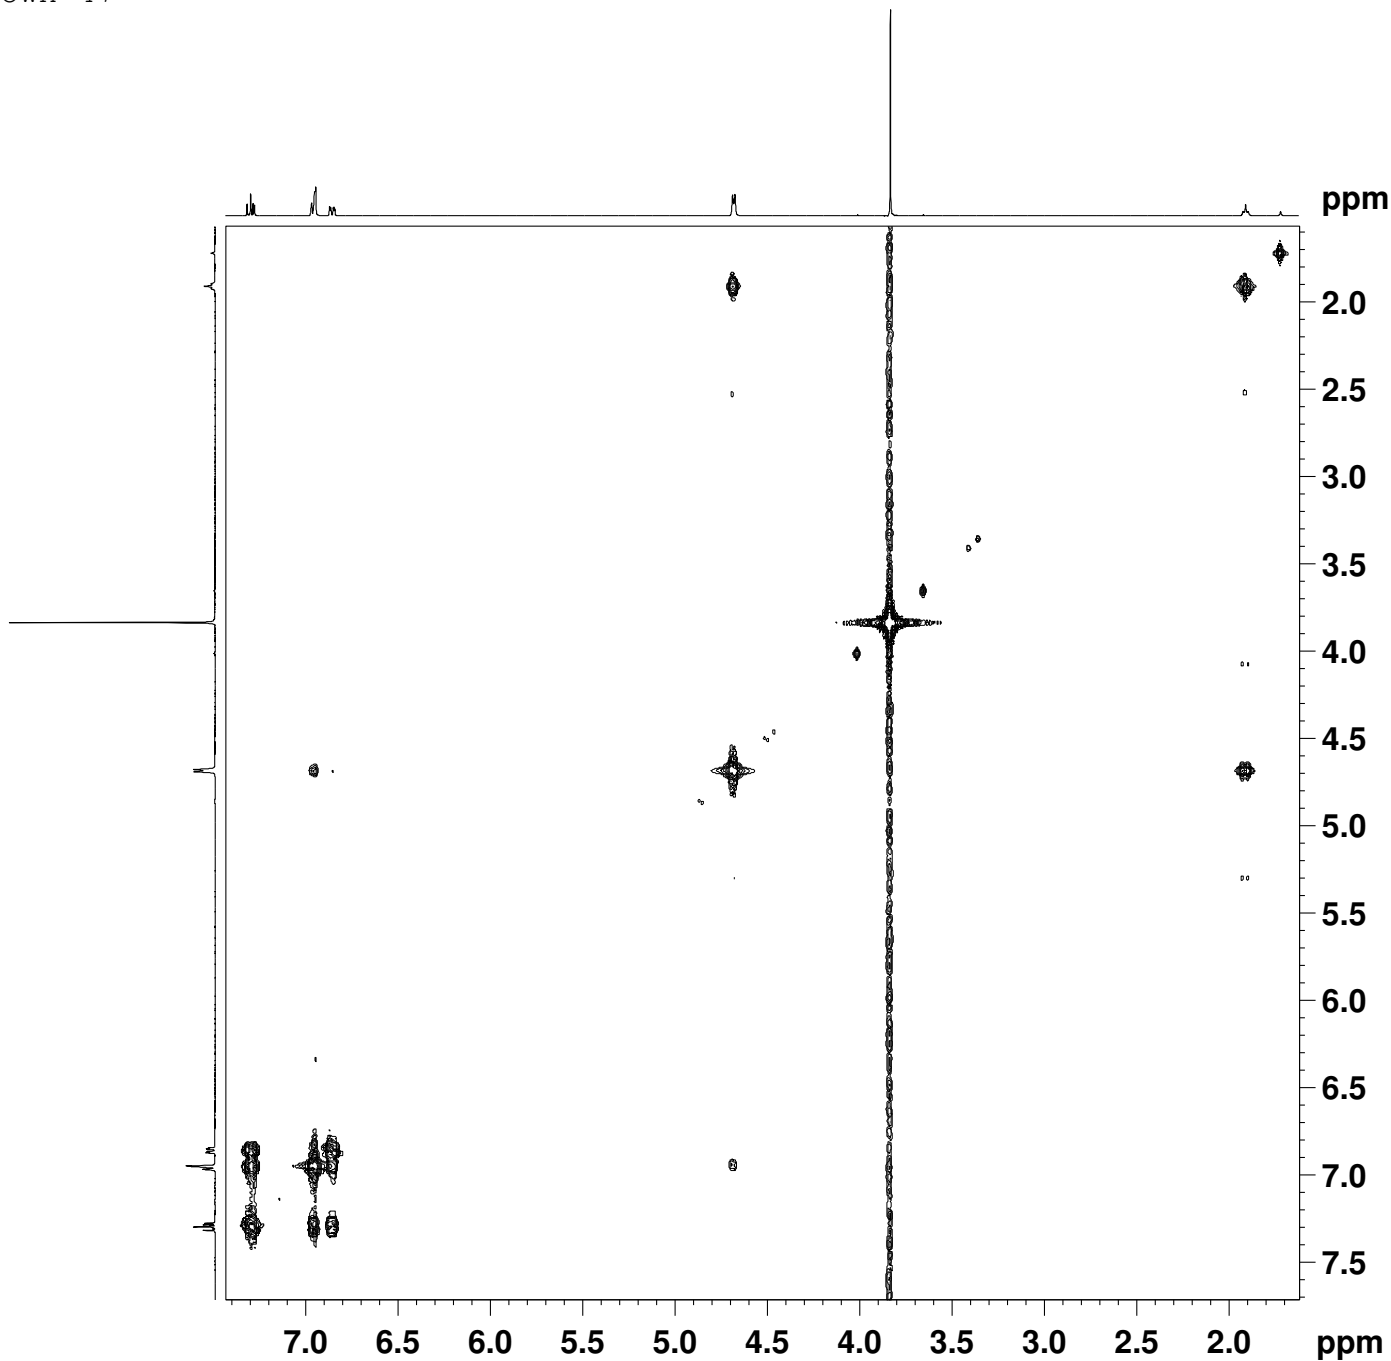

```
NAME Un_47
EXPNO 3
PROCNO 1
Date_ 20120222
Time_ 15.44
INSTRUM robinson
PROBHD 5 mm PABBO BB-
PULPROG cosygpgf
TD 2048
SOLVENT CDC13
NS 2
DS 8
SWH 3591.954 Hz
FIDRES 1.753884 Hz
AQ 0.2851316 sec
RG 128
DW 139.200 usec
DE 6.50 usec
TE 298.2 K
D0 0.00000300 sec
D1 2.00000000 sec
D13 0.00000400 sec
D16 0.00020000 sec
IN0 0.00027840 sec

===== CHANNEL f1 =====
NUC1 1H
P0 14.00 usec
P1 14.00 usec
PL1 0.00 dB
SFO1 400.1418006 MHz

===== GRADIENT CHANNEL =====
GPNAM1 SINE.100
GPZ1 10.00 %
P16 1000.00 usec
ND0 1
TD 256
SFO1 400.1418 MHz
FIDRES 14.031069 Hz
SW 8.977 ppm
FnMODE QF
SI 2048
SF 400.1400000 MHz
WDW SINE
SSB 0
LB 0.00 Hz
GB 0
PC 1.40
SI 2048
MC2 QF
SF 400.1400000 MHz
WDW SINE
SSB 0
LB 0.00 Hz
GB 0
```