


unknown 52

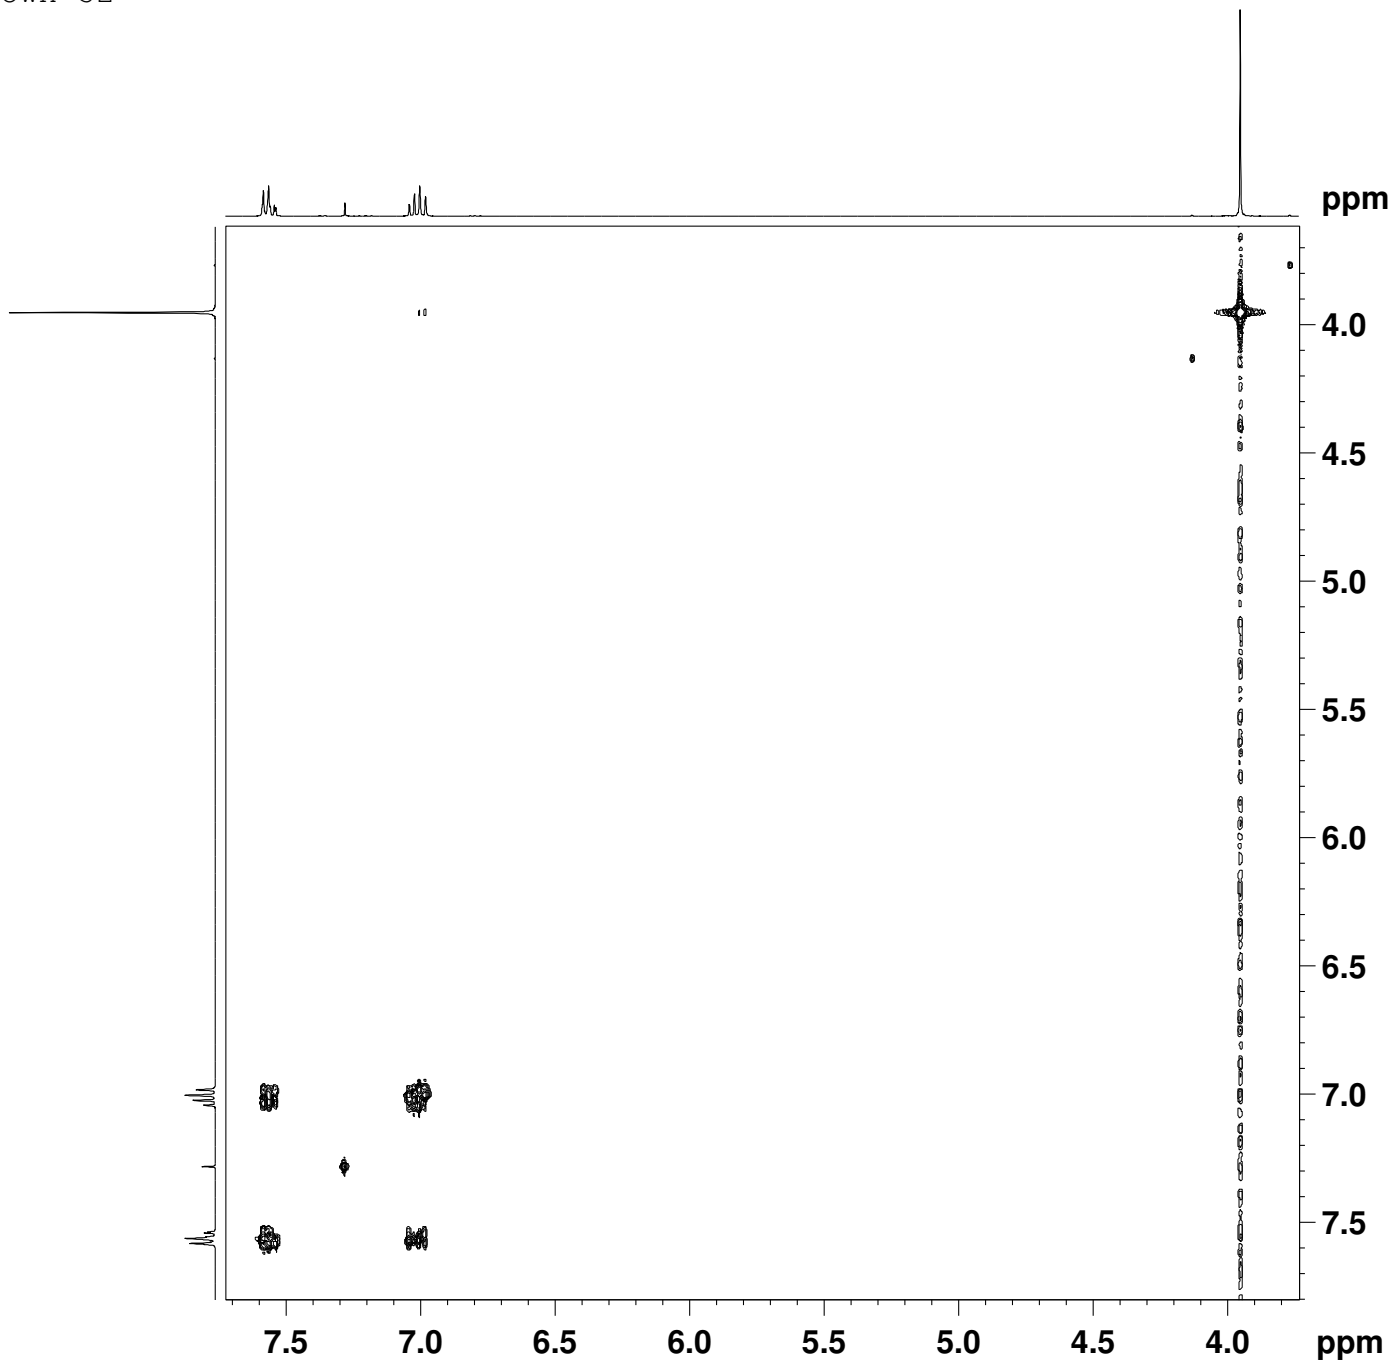

```
NAME           Un_52
EXPNO          3
PROCNO         1
Date_          20120224
Time           15.04
INSTRUM        robinson
PROBHD         5 mm PABBO BB-
PULPROG        cosygpgf
TD             2048
SOLVENT        CDC13
NS             2
DS             8
SWH            2394.636 Hz
FIDRES         1.169256 Hz
AQ             0.4276724 sec
RG            181
DW            208.800 usec
DE             6.50 usec
TE            298.2 K
D0            0.00000300 sec
D1            2.00000000 sec
D13           0.00000400 sec
D16           0.00020000 sec
IN0           0.00041760 sec

===== CHANNEL f1 =====
NUC1           1H
P0            14.00 usec
P1            14.00 usec
PL1           0.00 dB
SFO1          400.1424008 MHz

===== GRADIENT CHANNEL =====
GPNAM1        SINE.100
GPZ1          10.00 %
P16           1000.00 usec
ND0           1
TD            256
SFO1          400.1424 MHz
FIDRES        9.354059 Hz
SW            5.984 ppm
FnMODE        QF
SI            2048
SF            400.1400000 MHz
WDW           SINE
SSB           0
LB            0.00 Hz
GB            0
PC            1.40
SI            2048
MC2           QF
SF            400.1400000 MHz
WDW           SINE
SSB           0
LB            0.00 Hz
GB            0
```