


unknown 52

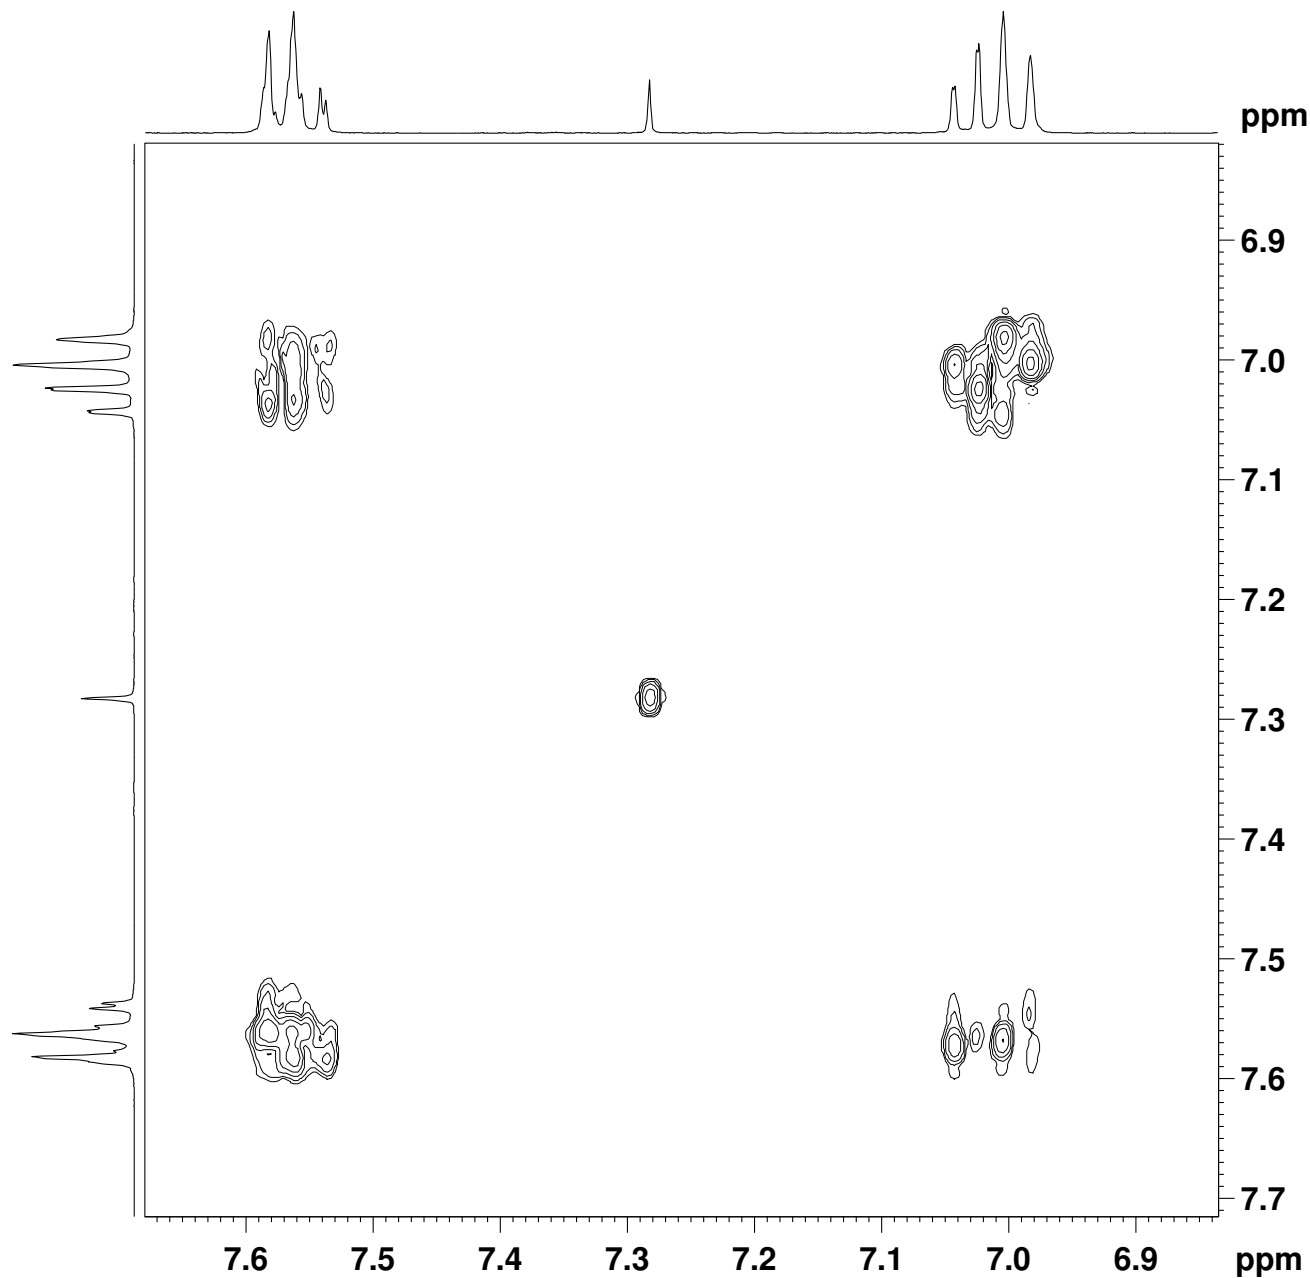

```
NAME           Un_52
EXPNO           3
PROCNO          1
Date_           20120224
Time            15.04
INSTRUM         robinson
PROBHD          5 mm PABBO BB-
PULPROG         cosygpgqf
TD              2048
SOLVENT         CDC13
NS              2
DS              8
SWH             2394.636 Hz
FIDRES          1.169256 Hz
AQ              0.4276724 sec
RG              181
DW              208.800 usec
DE              6.50 usec
TE              298.2 K
D0              0.00000300 sec
D1              2.00000000 sec
D13             0.00000400 sec
D16             0.00020000 sec
IN0             0.00041760 sec
```

```
===== CHANNEL f1 =====
NUC1            1H
P0              14.00 usec
P1              14.00 usec
PL1             0.00 dB
SFO1            400.1424008 MHz
```

```
===== GRADIENT CHANNEL =====
GPNAM1         SINE.100
GPZ1           10.00 %
P16            1000.00 usec
ND0            1
TD             256
SFO1            400.1424 MHz
FIDRES          9.354059 Hz
SW              5.984 ppm
FnMODE         QF
SI              2048
SF              400.1400000 MHz
WDW            SINE
SSB            0
LB              0.00 Hz
GB              0
PC              1.40
SI              2048
MC2            QF
SF              400.1400000 MHz
WDW            SINE
SSB            0
LB              0.00 Hz
GB              0
```