


Unknown 59

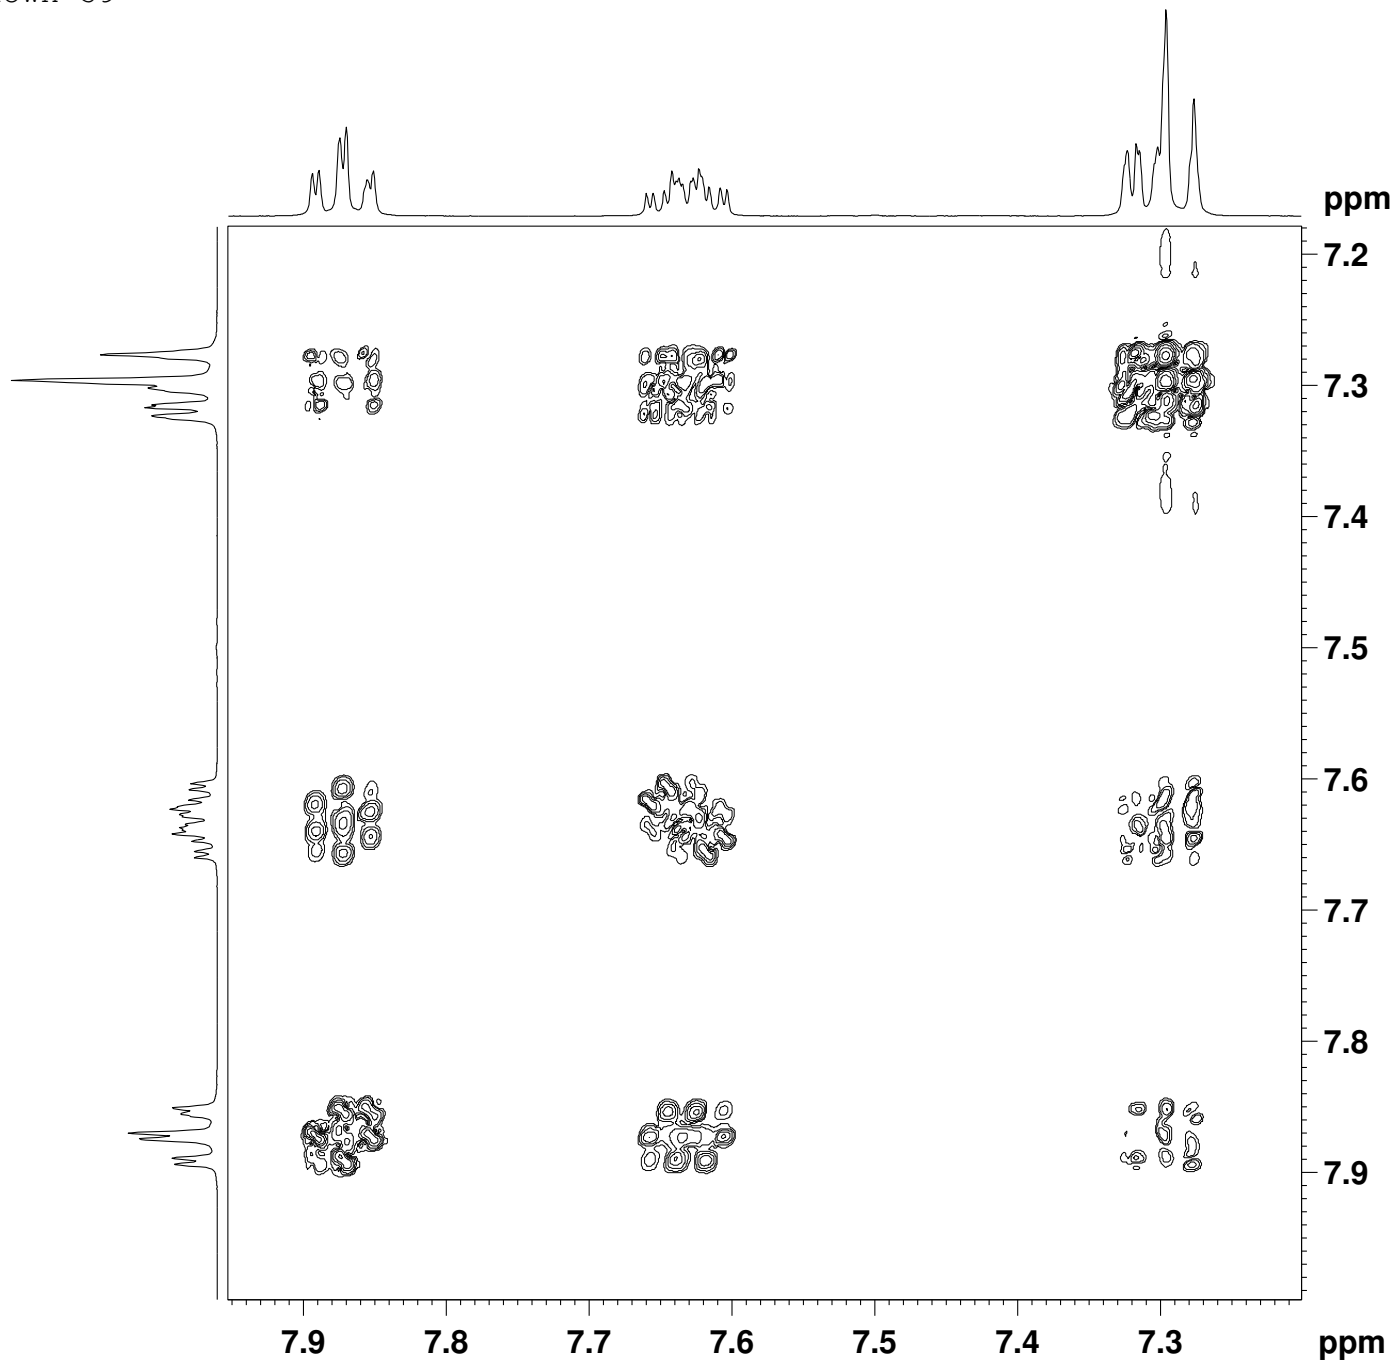

```
NAME           Un_59
EXPNO           3
PROCNO          1
Date_           20120229
Time            11.31
INSTRUM         robinson
PROBHD          5 mm PABBO BB-
PULPROG         cosygpqf
TD              1024
SOLVENT         DMSO
NS              2
DS              8
SWH             801.282 Hz
FIDRES          0.782502 Hz
AQ              0.6390260 sec
RG              128
DW              624.000 usec
DE              6.50 usec
TE              298.2 K
D0              0.00000300 sec
D1              2.00000000 sec
D13             0.00000400 sec
D16             0.00020000 sec
IN0             0.00124800 sec
```

```
===== CHANNEL f1 =====
NUC1            1H
P0              14.00 usec
P1              14.00 usec
PL1             0.00 dB
SFO1            400.1430011 MHz
```

```
===== GRADIENT CHANNEL =====
GPNAM1          SINE.100
GPZ1            10.00 %
P16             1000.00 usec
ND0             1
TD              256
SFO1            400.143 MHz
FIDRES          3.130017 Hz
SW              2.002 ppm
FnMODE          QF
SI              2048
SF              400.1400000 MHz
WDW             SINE
SSB             0
LB              0.00 Hz
GB              0
PC              1.40
SI              2048
MC2             QF
SF              400.1400000 MHz
WDW             SINE
SSB             0
LB              0.00 Hz
GB              0
```