


Unknown 62

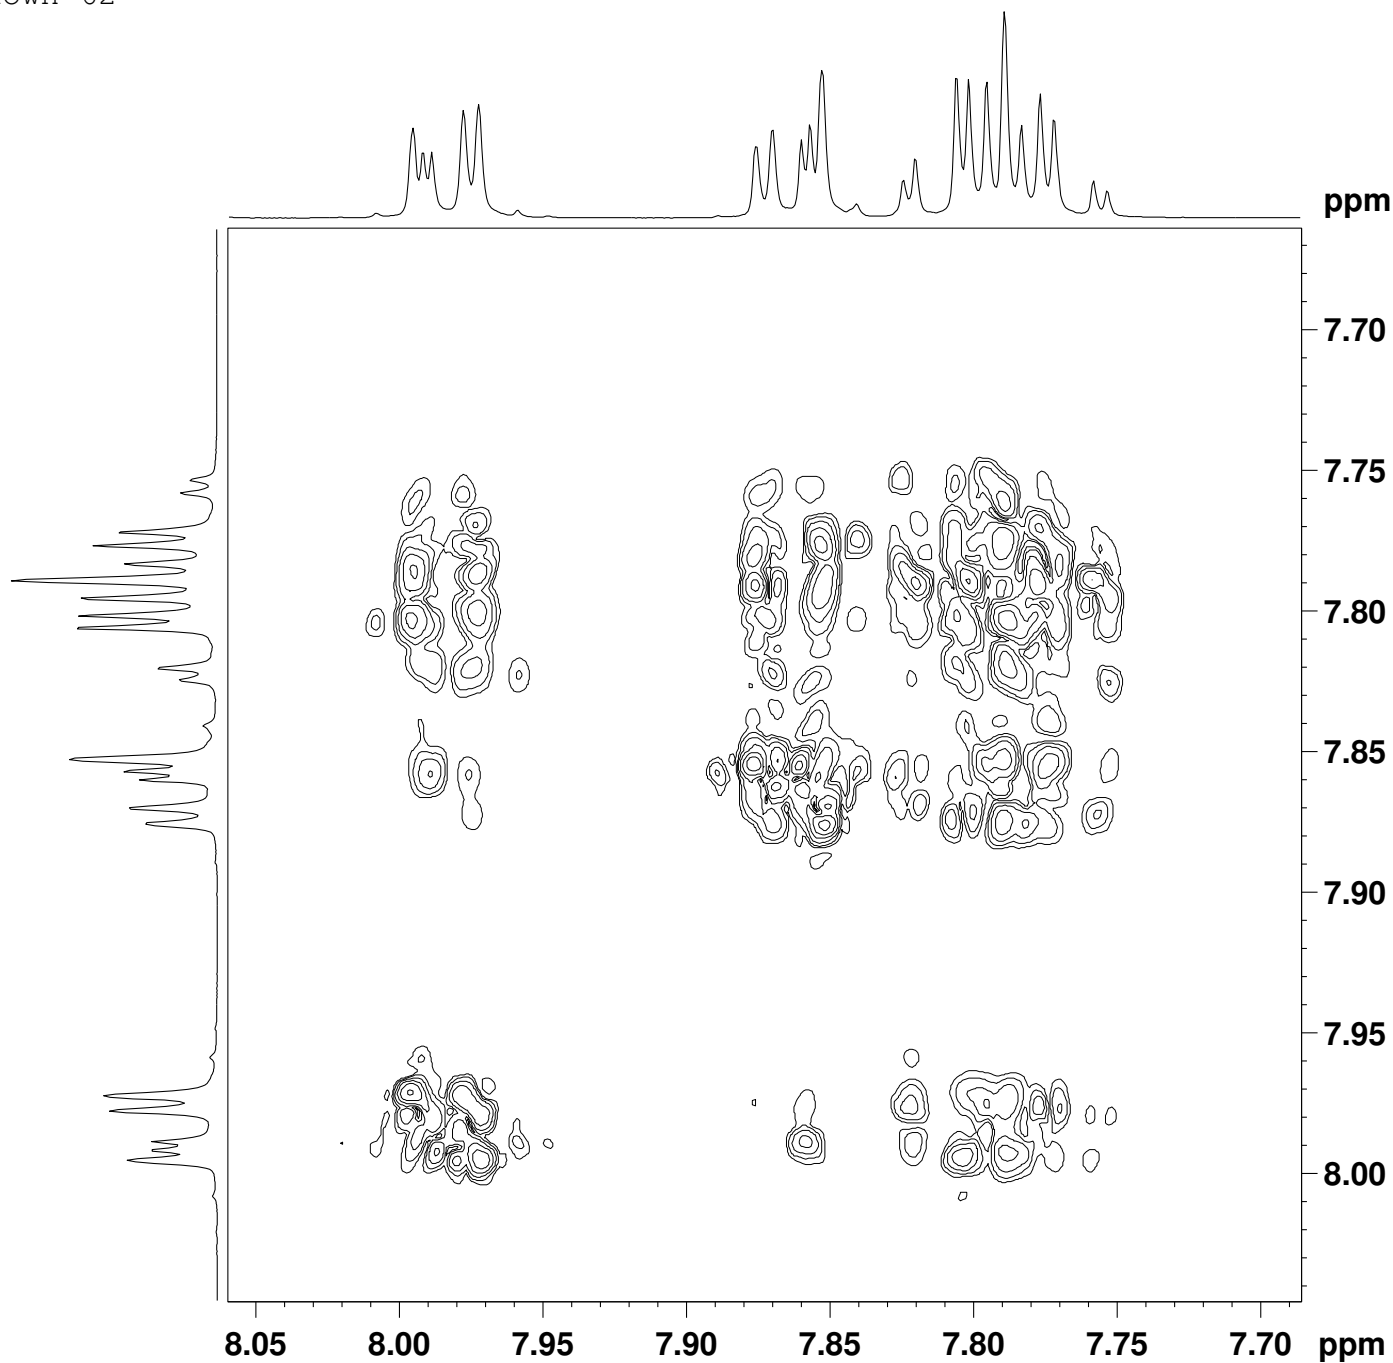

NAME Un\_62  
EXPNO 3  
PROCNO 1  
Date\_ 20120301  
Time 8.47  
INSTRUM robinson  
PROBHD 5 mm PABBO BB-  
PULPROG cosygpgf  
TD 1024  
SOLVENT DMSO  
NS 2  
DS 8  
SWH 801.282 Hz  
FIDRES 0.782502 Hz  
AQ 0.6390260 sec  
RG 812.7  
DW 624.000 usec  
DE 6.50 usec  
TE 298.2 K  
D0 0.00000300 sec  
D1 2.00000000 sec  
D13 0.00000400 sec  
D16 0.00020000 sec  
IN0 0.00124800 sec

==== CHANNEL f1 =====  
NUC1 1H  
P0 14.00 usec  
P1 14.00 usec  
PL1 0.00 dB  
SFO1 400.1431211 MHz

===== GRADIENT CHANNEL =====  
GPNAM1 SINE.100  
GPZ1 10.00 %  
P16 1000.00 usec  
ND0 1  
TD 256  
SFO1 400.1431 MHz  
FIDRES 3.130018 Hz  
SW 2.002 ppm  
FnMODE QF  
SI 2048  
SF 400.1400000 MHz  
WDW SINE  
SSB 0  
LB 0.00 Hz  
GB 0  
PC 1.40  
SI 2048  
MC2 QF  
SF 400.1400000 MHz  
WDW SINE  
SSB 0  
LB 0.00 Hz  
GB 0